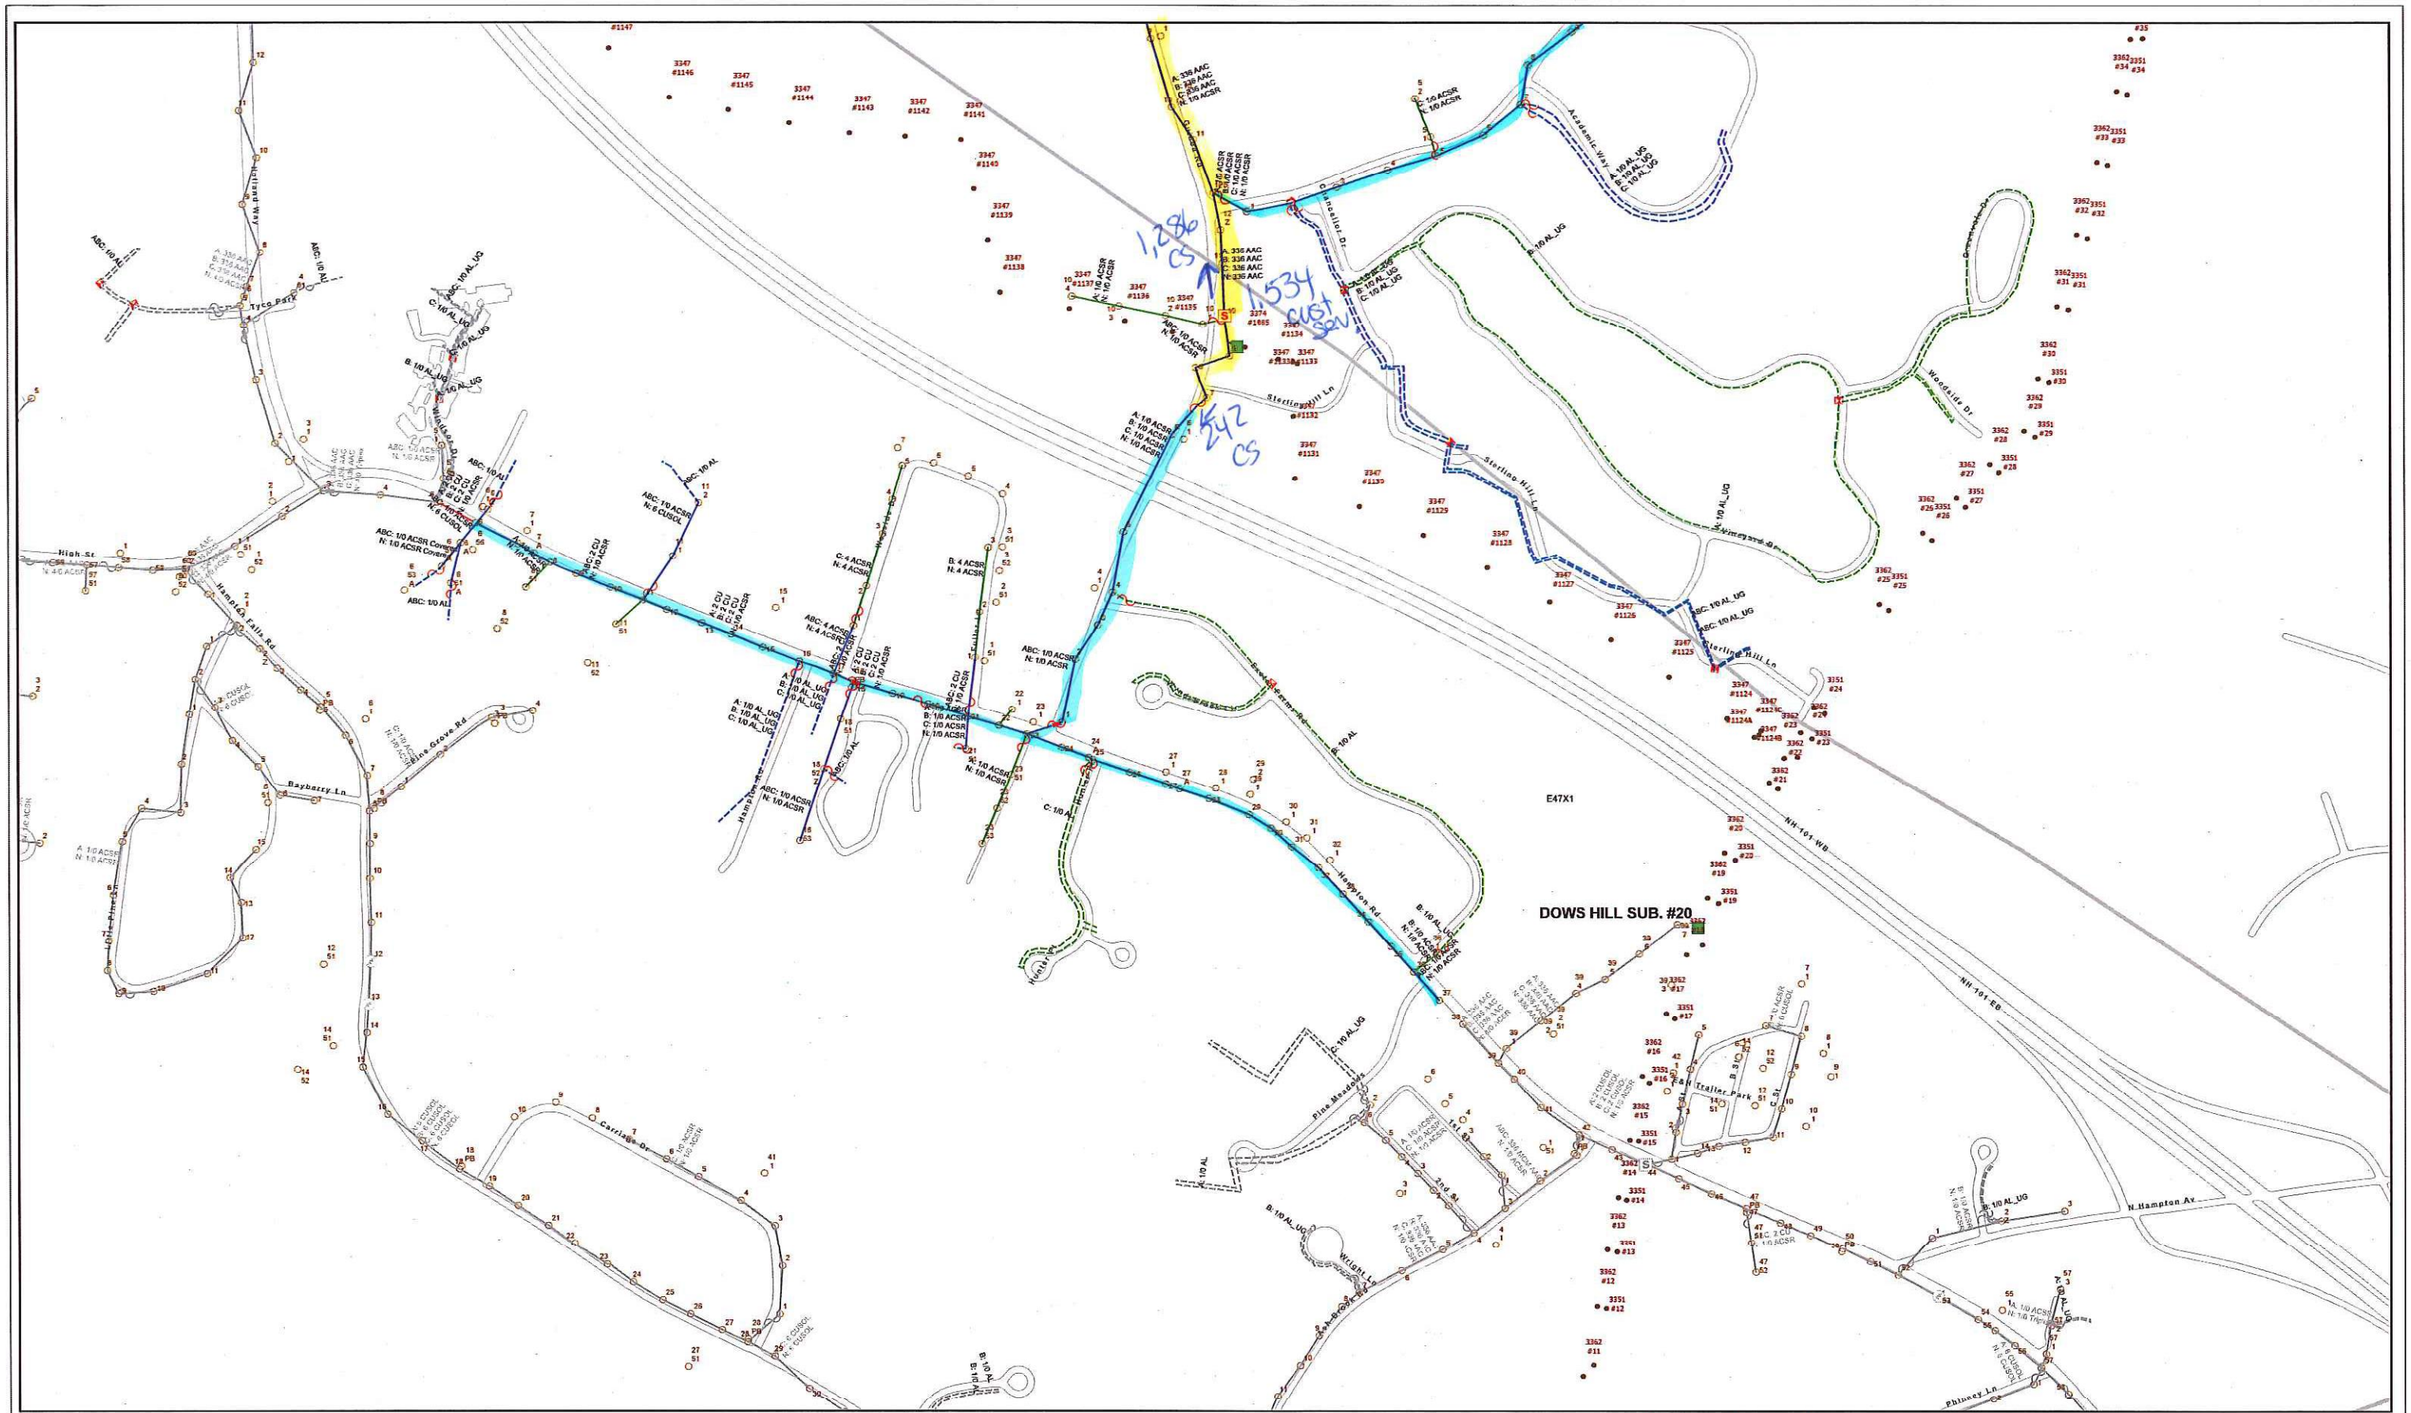

New Hampshire Storm Hardening Pilot Program 2016

- Hazard Tree Only
- Ground to Sky and Hazard Tree
- Scenic Road Hazard Tree

Capacitor
- Fixed Capacitor Bank
- Switched Capacitor Bank
- Unknown Capacitor Bank

Dynamic Protective Device
- R Recloser
- S Sectionalizer, Tank Enclosed
- S Sectionalizer, Cutout Mounted
- Recloser as Circuit Source
- Fault Indicator

Fuse
- Solid Fuse
- Fuse

Transformer
- 1 Phase OH Trans
- 2 Phase OH Trans
- 3 Phase Bank OH Trans
- 3 Phase OH Single Trans
- Step Transformer
- 1 Phase UG Trans
- 3 Phase UG Trans
- Regulator Bank

Switch
- Overhead Switch, Disconnect
- Overhead Switch, Gang

Surface Structure
- Switch Cabinet
- Junction Box

Primary OH Conductor Phasing Code
- Single Phase
- Multi Phase

Primary UG Conductor Phasing Code
- Single Phase
- Multi Phase

Underground Structure
- Vault
- Handhole
- Manhole
- Pullbox

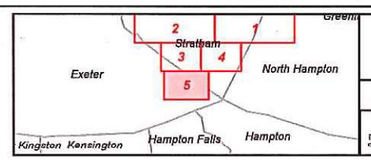

Electric Distribution System
E47X1 MAP 5

Disclaimer: Unitil has prepared these maps based on best available information. The information provided is not warranted for accuracy and may be incomplete. Field verification is advised for all information shown on the maps.

SCALE 0 100 200 600 Feet

DATE 4/6/2016

Unitil